

**EVALUATION REPORT OF
UNION CORRUGATING COMPANY
'26 GA. MASTERRIB PANEL'
OVER STEEL SUPPORTS**


**FLORIDA PRODUCT APPROVAL
FL 9555.2-R2
STRUCTURAL COMPONENTS
ROOF DECK**

**Prepared For:
Union Corrugating Company
P. O. Box 229
Fayetteville, NC 28302
Telephone: (910) 483-0479
Fax: (910) 483-8897**

**Prepared By:
Bala Sockalingam, Ph.D., P.E.
Florida Professional Engineer #62240
1216 N Lansing Ave., Suite C
Tulsa, OK 74106
Telephone: (918) 492-5992
FAX: (866) 366-1543**

**This report consists of
Evaluation Report (2 Pages including cover)
Installation Details (1 Page)**

**Report No. C1805-4
Date: 11.25.2011**

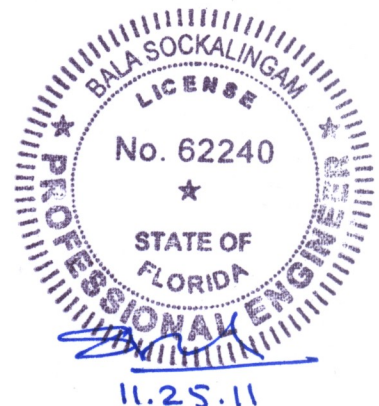

Manufacturer: Union Corrugating Company

Product Name: MasterRib Panel

Panel Description: 36" wide coverage with 3/4" high ribs at 9" o.c.

Materials: Minimum 26 ga., 80 ksi steel. Galvanized coated steel (ASTM A653) or Galvalume coated steel (ASTM A792) or painted steel (ASTM A755).

Support Description: Min 16 ga., 50 ksi steel

Slope: 1/2:12 or greater in accordance with FBC 2010 Section 1507.4.2

Design Uplift Pressure: 47.15 psf @ maximum support spacing of 60" o.c.
(Factor of Safety = 2)

Support Attachment: #12-14 x 1" long SDS
At end supports @ 3.5"-5.5"-3.5" o.c. across panel width
At intermediate supports @ 9" o.c. across panel width

Sidelap Attachment: 1/4"-14 x 7/8" long SDS @ 30" o.c.



Test Standards: Roof assembly tested in accordance with ASTM E1592-01 'Test Method for Structural Performance of Sheet Metal Roof and Siding Systems by Uniform Static Air Pressure Difference' and FM 4470 Section 5.5 'Resistance to Foot Traffic'.

Code Compliance: The product described herein has demonstrated compliance with FBC 2010 Section 1507.4.


Product Limitations: Design wind loads shall be determined for each project in accordance with FBC 2010 Section 1609 or ASCE 7-10 using allowable stress design. The maximum support spacing listed herein shall not be exceeded. The design uplift pressure for reduced support spacing may be computed using rational analysis prepared by a Florida Professional Engineer. This product is not approved for use in the High Velocity Hurricane Zone. Fire classification is not within scope of this Evaluation Report. Refer to FBC 2010 Section 1505 and current approved roofing materials directory for fire ratings of this product.

Supporting Documents: ASTM E1592 Test Reports
Farabaugh Engineering and Testing Inc
Project No. T163-06, Reporting Date 6/7/06

FM 4470 Test Report
ENCON Technology Inc
C1583-2, Reporting Date 7/24/08

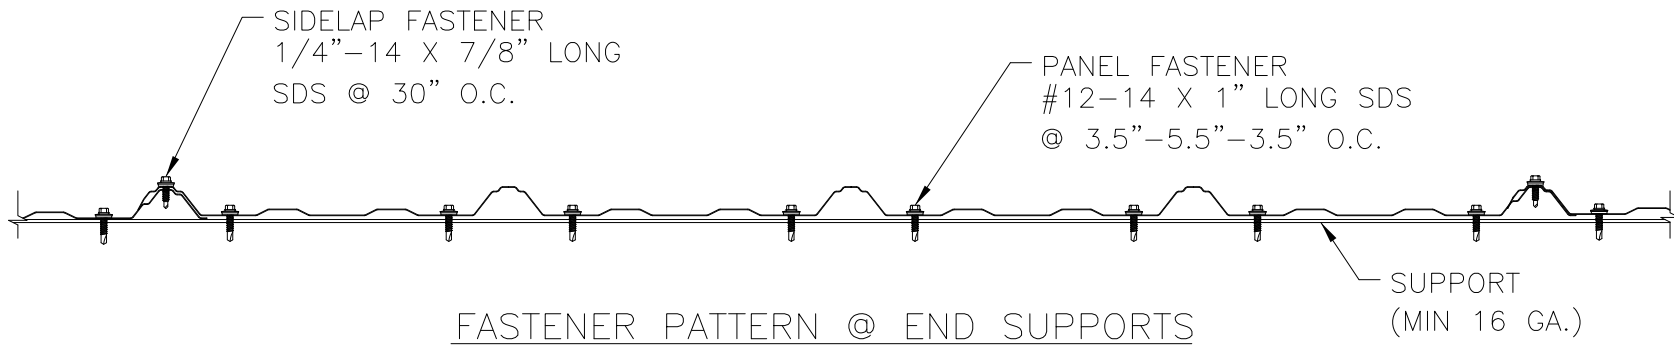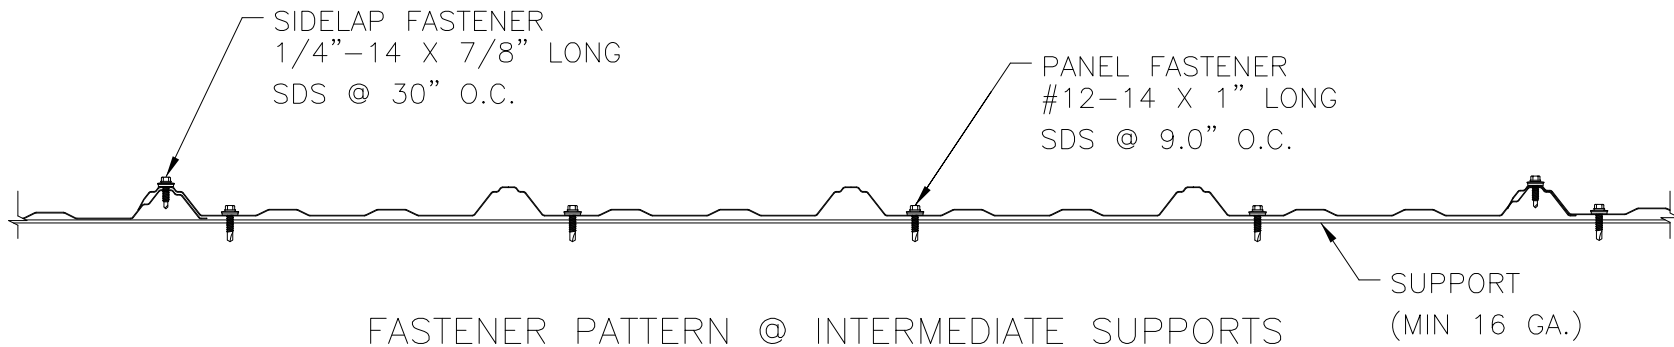

ALLOWABLE UPLIFT PRESSURE = 47.15 PSF @
SUPPORT SPACING OF 60" O.C.

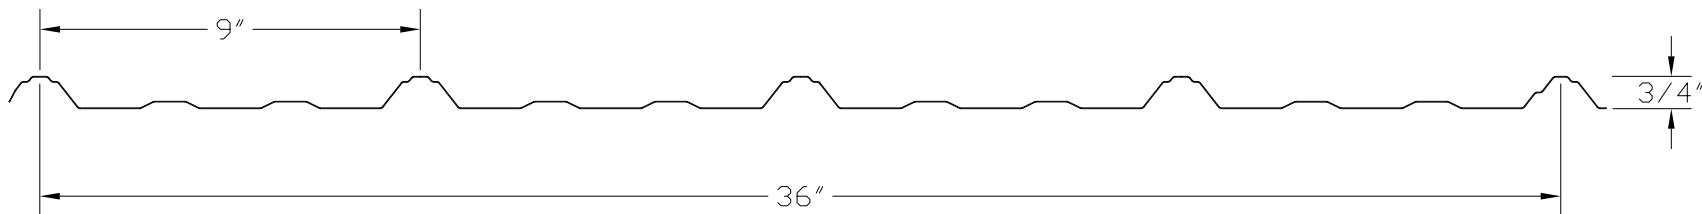

MasterRib Panel Profile

Min 26 Gauge, Minimum Yield = 80 KSI

CAD FILE: MASTERRIB		SCALE: NONE	DRAWN: Bala Sothalingam	DATE: 11-23-2011	REV: 1	DATE: 11-23-2011
UNION CORRUGATING COMPANY 701 SOUTH KING ST FAYETTEVILLE, NC 28302 Ph: 810-485-2185 Fax: 810-485-1981		MasterRib Panel		CHECKED: APPROVED:	REVISIONS	
DATE: 11-23-2011		1 OF 1				